Description
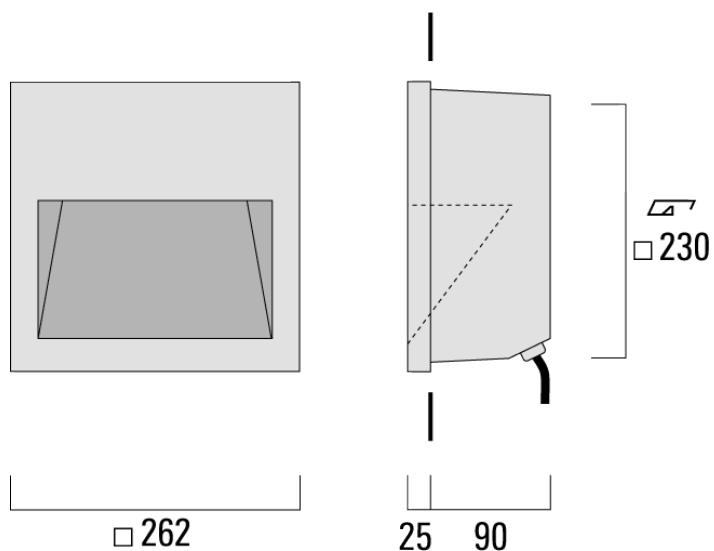
IP55, Class I. IK08. Marine-grade, die-cast aluminium alloy. 5CE superior corrosion protection including PCS hardware. Silicone rubber gasket. Safety glass lens. Two cable entries.

A pre-installation blockout is available and recommended for mounting in concrete walls

□ 262

□ 230

25   90

Specifications
Material description

Body	Marine-grade, die-cast aluminium alloy
Lens	Safety glass lens
Colours	RAL9004 Signal black
	RAL9006 White aluminium
	RAL9007 Grey aluminium
	RAL7016 Anthracite grey
	RAL9016 Traffic white
Gasket	Silicone rubber gasket
Fasteners	PCS Polymer Coated Stainless Steel Hardware
Ingress protection	IP55
Impact resistance	IK08
Corrosion resistance	5CE

Electrical description

Power supply	220-240V / 50-60 Hz
Driver / Ballast	Integral EC electronic converter
Surge protection	1/2 kV

Additional information

Lifetime	LED >60,000 h Ta 25°(B10/70) Control gear >50,000 h Ta 25°

Options

Light distribution	Colour temperature	Nominal Watt
asymmetric, forward throw [A60]	3000 K	0 W
	4000 K	
	2700 K	

Configurations

Light distribution	Part ID	Light source	Rated lumens	Rated input power	CRI	Weight (kg)
asymmetric, forward throw [A60]	197-9084	LED-12W / 350 mA - 3000 K	511.9	15 W	80	3.40
	197-9086	LED-12W / 350 mA - 4000 K	531	15 W	80	3.40
	197-9091	LED-12W / 350 mA - 2700 K	473.6	15 W	80	3.40

Subject to technical changes and errors. - Generated on 06/12/2025

Mounting Accessories

Installation blockout

Description	Part ID	A	B	C1	C
Installation blockout BQR35-I	197-0129	272	272	125	125
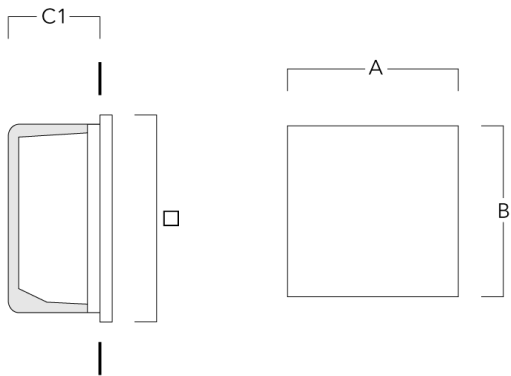
Description	Part ID	A	B	C1	C
Installation blockout BQR35-II	197-0132	272	272	150	150

we-ef
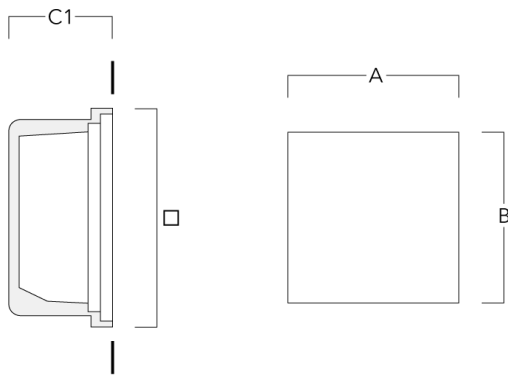
Control

DALI interface

Description	Part ID	Additional information	C
DALI interface	430-0013	DALI variant. The luminaire is equipped with a DT6 Dali driver (Dali 2.0).	90
		Dali 2.0 -Application controllers and Input devices defined -Single-masters and multi-masters allowed -Event priorities defined -Separate addressing & grouping from control gear Note: Mixing Dali 1 and Dali 2.0 drivers can cause problems because the addressing and the command scope has changed!	