



WE-EF LIGHTING

Installation and Maintenance
Instructions

Wall Luminaire Surface Mounted

FLC122 LED

FLC142 LED



Do not open during installation

This product is factory-sealed.
Refer to the instructions contained in this document for details.



Surge Protection

This product features built-in surge protection circuitry in compliance with applicable standards.


For comprehensive protection of a luminaire installation against lightning and electrical surges, it is essential to cover mains supply and data input lines at the distribution board level, by using respective primary (Type 1) and secondary (Type 2) surge arrestors in compliance with EN61643-11/ IEC61643-1.

Warning


Ensure that all required surge protection measures are in place and activated prior to luminaire installation. Also, disconnect luminaires before operating high-power devices such as, for example, electrical arc welders.

Wall Luminaire Surface Mounted

FLC122

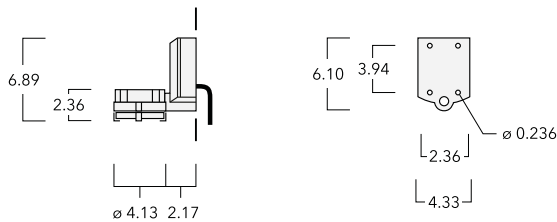

FLC142

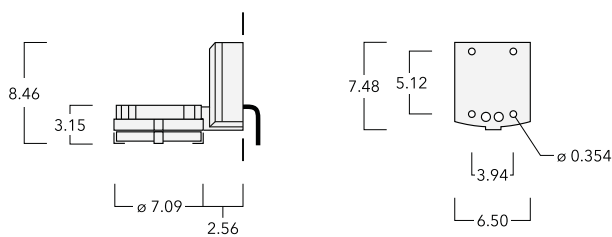

IP55, IK07, Class I, ta= 40°C

Light Source

LED

Maintenance

Apart from cleaning the product's exterior surfaces, no special maintenance work is required.

Do not use high-pressure cleaners.

In case of component failure due to abnormal circumstances or at end of life, replacement must be carried out by a suitably qualified and trained professional.

Warning: Do not open luminaire while mains supply is switched on.

Installation

The product must be installed and maintained by a suitably qualified professional in compliance with latest building/construction and/or electrical regulations and relevant legislation.






Warning: Switch off mains electrical supply prior to installing and connecting the luminaire.

Notice: If the luminaire is modified by anybody other than the original manufacturer, then the warranty will no longer be valid and shall become the full responsibility of the modifying person/organisation.


Claims based on defects attributable to improper installation and/or application, and the consequences thereof, are excluded.

The installation on site must comply with local and/or national health and safety regulations.


Installation Procedure
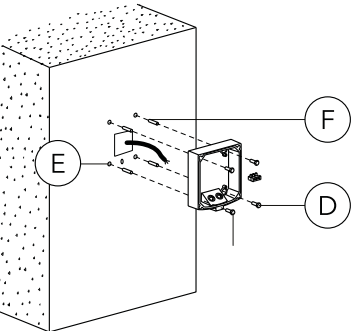
<div>1) Switch off mains electrical supply.</div> <div></div>	<div>2) Remove mounting flange A by loosening screws B.</div> <div></div>
<div>3) Check that rating shown on luminaire label conforms with mains electrical supply.</div> <div><div><div><div>we-ef</div><div>12/17 IP55 </div></div><div><div>FLC122-LED </div><div>120-277V/60Hz</div></div><div><div>145-XXXX</div><div>SOE XXXXXXXX</div></div><div><div>LED 3000K 12W</div><div>item no. XXX</div></div></div></div> <div>(example)</div>	<div>4) Determine position for fixing screws D. Drill relevant holes E and insert nylon plugs F.</div> <div>Warning: Ensure not to damage any electrical cable, water pipe or other items drilling holes.</div> <div></div>


- 5) Feed mains supply cable **G** (and second cable **H** for through wiring, if required) through fixture opening **I**, while setting mounting flange **A** in position.

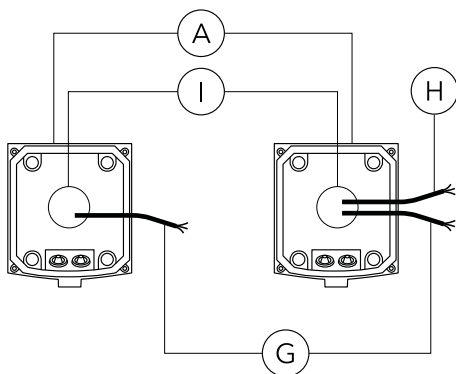


- 6) To fix mounting flange **A**, pierce through nylon plugs **J** by inserting and tightening screws **D**.
Attention: Nylon plugs **J** must remain in position to provide sealing.

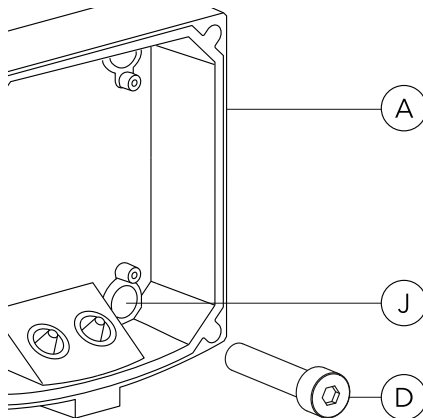

- 7) Connect mains supply cable **G** leads to respective terminals in of LED Driver **K**:
a) ON/OFF (L = Phase, N = Neutral, ⊕ = Earthing)
b) 0-10 V (L = Phase, N = Neutral, ⊕ = Earthing, D-/D+ = 0-10 V control line).

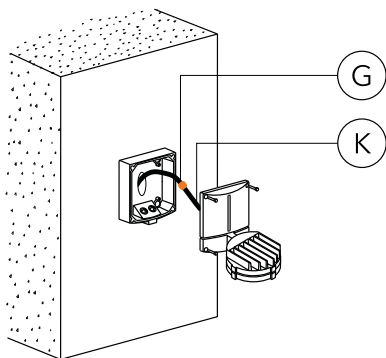

- 8) Ensure that all surfaces are clean and dry.
Position luminaire over mounting flange **A**.
Tighten screws **B**.

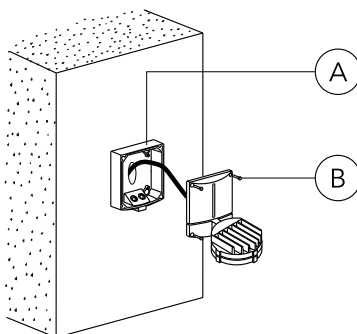

we-ef

www.we-ef.com

WE-EF LIGHTING

United States of America

Tel +1 724 742 0030

Fax +1 724 742 0035

info.usa@we-ef.com

TO9205W0422 © WE-EF 2022

Technical specifications are
subject to change.