we-ef

WE-EF LIGHTING

Installation and Maintenance Instructions

Bollard KTX234 LED





Do not open during installation

This product is factory-sealed. Refer to the instructions contained in this document for details.



Installation tools

Mounting hardware used on this product includes fasteners with hexalobular socket heads (ISO 10664). Installation requires the use of matching tools.



Surge Protection


This product features built-in surge protection circuitry in compliance with applicable standards.

For comprehensive protection of a luminaire installation against lightning and electrical surges, it is essential to cover mains supply and data input lines at the distribution board level, by using respective primary (Type 1) and secondary (Type 2) surge arrestors in compliance with EN61643-11/ IEC61643-1.

Warning

Ensure that all required surge protection measures are in place and activated prior to luminaire installation. Also, disconnect luminaires before operating high-power devices such as, for example, electrical arc welders.

Bollard

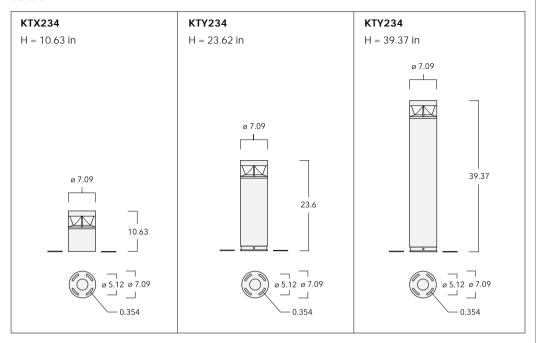


IP66, IK10, Class I, ta = 40°C

Weight	Н	lb
for KTX234	10.63	9.9
for KTY234	23.62	15.0
for KTY234	39.37	19.6

Accessories:

Planted root - Galvanised steel.			lb
ESV4	for KTX234/KTY234	300-0461	9.7



Light Source


LFD

Maintenance

Apart from cleaning the product's exterior surfaces, no special maintenance work is required. Do not use high-pressure cleaners.

To remove the head of the luminaire during maintenance, loosen screw $\bf J$ with Torx T-20 tool and rotate it anti-clockwise until it can be lifted up.

If the head of the luminaire is returned after maintenance, align it to the bollard post as shown below and secure by tightening screw **J**.

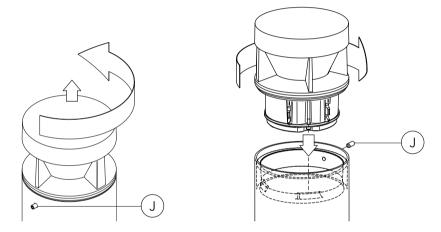

In case of component failure due to abnormal circumstances or at end of life, replacement must be carried out by a suitably qualified and trained professional.

Warning: Do not open luminaire while mains supply is switched on.

Installation

The product must be installed and maintained by a suitably qualified professional in compliance with latest building/construction and/or electrical regulations and relevant legislation.

Warning: Switch off mains electrical supply prior to installing and connecting the luminaire.

Notice: If the luminaire is modified by anybody other than the original manufacturer, then the warranty will no longer be valid and shall become the full responsibility of the modifying person/organisation. Claims based on defects attributable to improper installation and/or application, and the consequences thereof, are excluded.

Attention: The luminaire is factory-sealed and does not need to be opened during installation.

The installation on site must comply with local and/or national health and safety regulations.

Installation Procedure

The luminaire is suitable for installation directly on to an even surface, however it is recommended to incorporate the provided anchor bolts or optional planted root to ensure maximum stability.


Installation - KTX


- 1) Switch off mains electrical supply.
- 2) Check that rating shown on luminaire label conforms with mains electrical supply.
- (if using planted root mounting accessory)
 A suitable recess to be provided for planted root A.
 Ensure that a solid foundation as well as sufficient

Note: Planted root installation instruction is available at the end of this document.


mains cable length are provided.


- 4) Remove head of luminaire H from bollard post B after loosening screw J with Torx T-20 tool and rotating it anti-clockwise until it can be lifted up.
- 5) Set bollard post **B** in position and secure by inserting and tightening provided mounting fasteners **I**. The direction of light for KTX [R65] is opposite the set screw **J**.
- 6) Connect luminaire cable E to mains supply cable F in watertight terminal connector G (not supplied by WE-EF):
 a) ON/OFF (L = Phase, N = Neutral, ⊕ = Earthing)
 - b) 0-10V (L = Phase, N = Neutral, = Earthing,
 - D-/D+ = 0-10V control line).
- Place watertight terminal connector G and excess cable inside bollard post B.
- Return head of luminaire H to bollard post B and secure by tightening screw J.

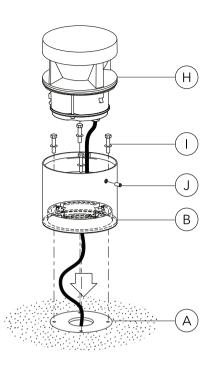




KTX234





Torque:

Screw	Torque	
M4	max.	2.0 Nm (17.7 in-lb)
M5	max	4.0 Nm (35.4 in-lb)
M6	max	6.0 Nm (53.1 in-lb)
M8	max.	15.0 Nm (132.8 in-lb)
M16	max.	100.0 Nm (885.1 in-lb)



Direction of Light for [R65] One-sided

we-ef

www.we-ef.com

WE-EF LIGHTING

United States of America Tel +1 724 742 0030 Fax +1 724 742 0035 info.usa@we-ef.com

TO9241W0422 © WE-EF 2022

Technical specifications are subject to change.

we-ef

WE-EF LIGHTING

Installation and Maintenance Instructions

Planted Root


ESV4

ESV2


ESV6



Planted Root

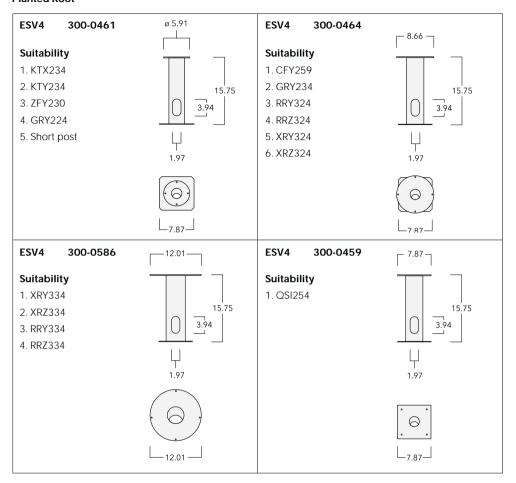


Planted Root

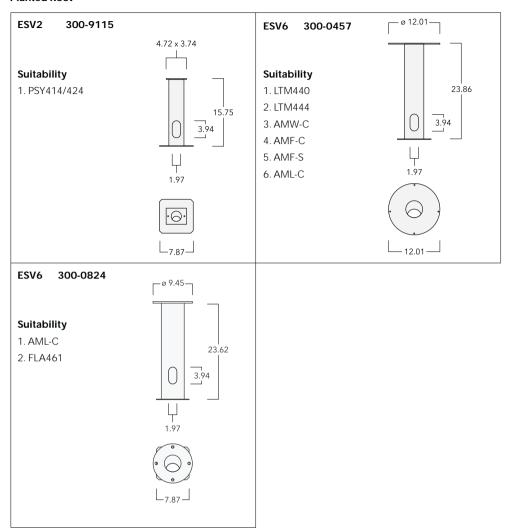


Installation Instruction

 Note: It is the responsibility to installer to ensure the suitability of the ESV planted root for any local or national structural requirements for installation, and that planted root is suitable for site specific conditions.

Instructions are a guideline for installation to these requirements and provide detail for installation orientation and mounting details.





When the ESV is being installed for following products: KTY234/KTX234/ZFY230/CFY259/FLA461, please orientate the planted root as shown (base plate is at an angle of 45° to the pathway). For this installation, use the M8 bolts supplied.






 For all other product that use ESV4 please orientate planted root as shown (base plate is parallel to the pathway). For this installation, use M8 bolts supplied. For ESV2 please orientate planted root as shown (base plate is parallel to the pathway).
 For this installation, use M12 bolts supplied.







- 5) For all other product that use ESV6 please orientate planted root as shown (base plate is parallel to the pathway). For this installation, use M16 bolts supplie.
- 6) Orientate ESV as required and fit electrical connections/conduit.






- 7) Place the ESV in the form work for concrete pad, ensuring orientation, position and levels are correct. Ensure all openings on ESV are blanked off, including mounting plate hole.
- 8) Fit the nominated bolts through mounting flange. Ensure several threads feed through the plate and tape off top and bottom. Bolts are inserted to protect threads off plate and need to be removed for fitting installation after setting the ESV.






9) Pour concrete to desired level depending on requirement of concrete, paver or soil. Ensure that for any installation mounting flange must be flush or higher than surrounding surface level.



 After concrete has cured for specified time, remove blanking and bolts. Install fitting (as per luminaire instructions) onto mounting flange.





WE-EF LIGHTING

United States of America Tel +1 724 742 0030 Fax +1 724 742 0035 info.usa@we-ef.com

TO9257W0422 © WE-EF 2022

Technical specifications are subject to change.